


I:\SUDBURY WATER DISTRICT 387\387-1901 WATER SUPPLY MASTER PLAN\10 OPTIMIZATION OF DISTRIBUTION SYSTEM FLUSHING PROGRAM\CAD\XREF\BASE MODEL.DWG



LEGEND:

- ① FLUSHING HYDRANT
- ⊠ VALVE CLOSURE
- ↑ FLOW DIRECTION
- < 6"
- 6"
- 8"
- 10"
- 12"
- 16"

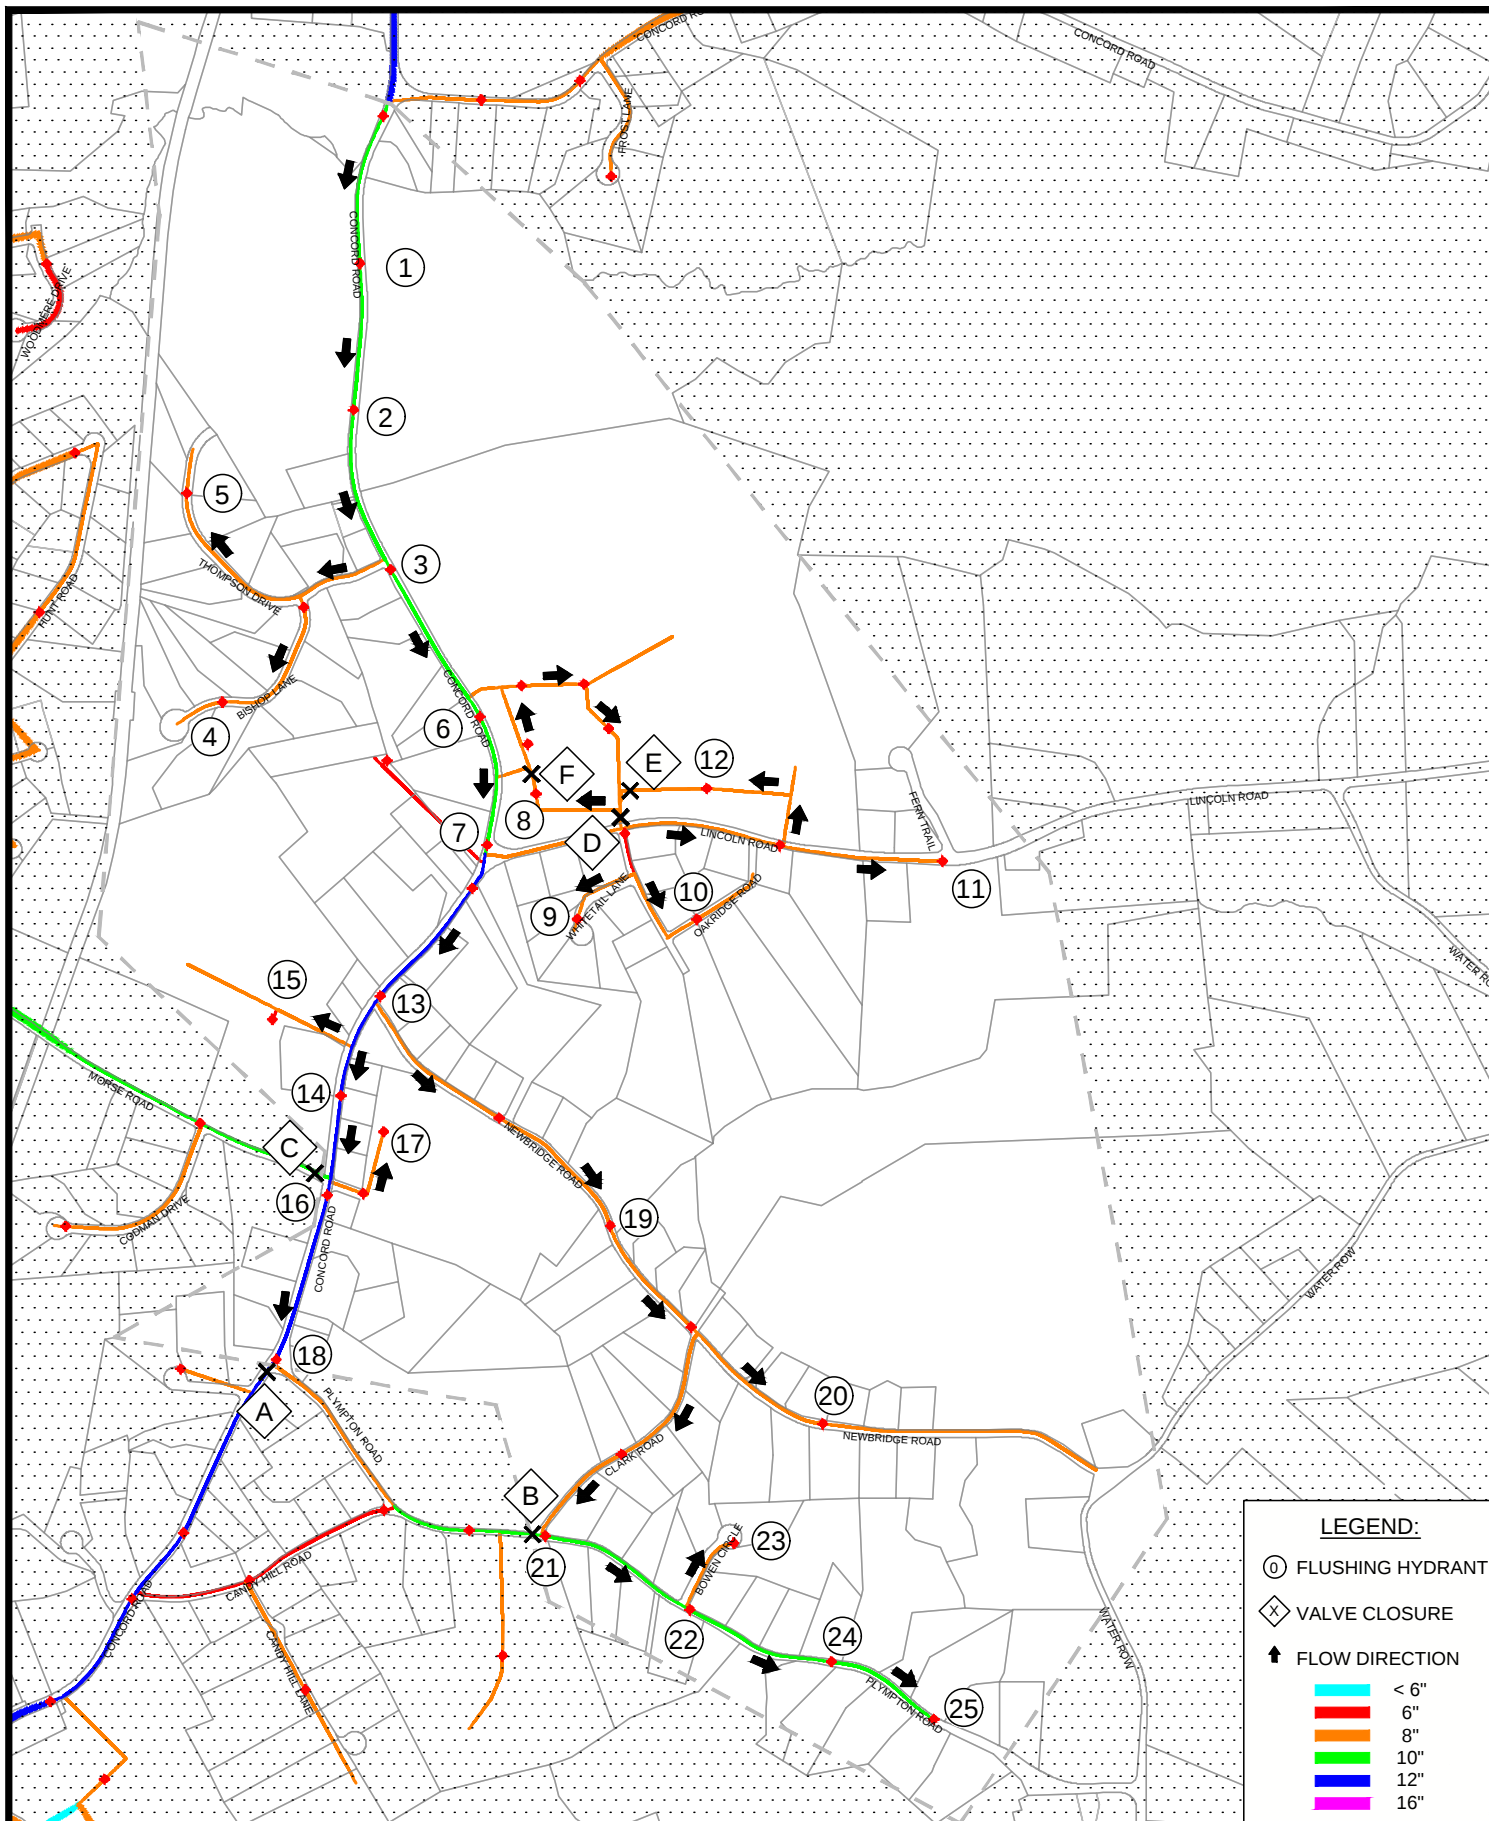

APRIL 2021
387-1901
SCALE: 1" = 750'

SUDBURY WATER DISTRICT
UNIDIRECTIONAL FLUSHING PROGRAM
ZONE: 10
Hydrants: 25
Valves: 6

