


I:\SUDBURY WATER DISTRICT 3871387-1901 WATER SUPPLY MASTER PLAN\10 OPTIMIZATION OF DISTRIBUTION SYSTEM FLUSHING PROGRAM\CAD\XREFS\BASE MODEL.DWG

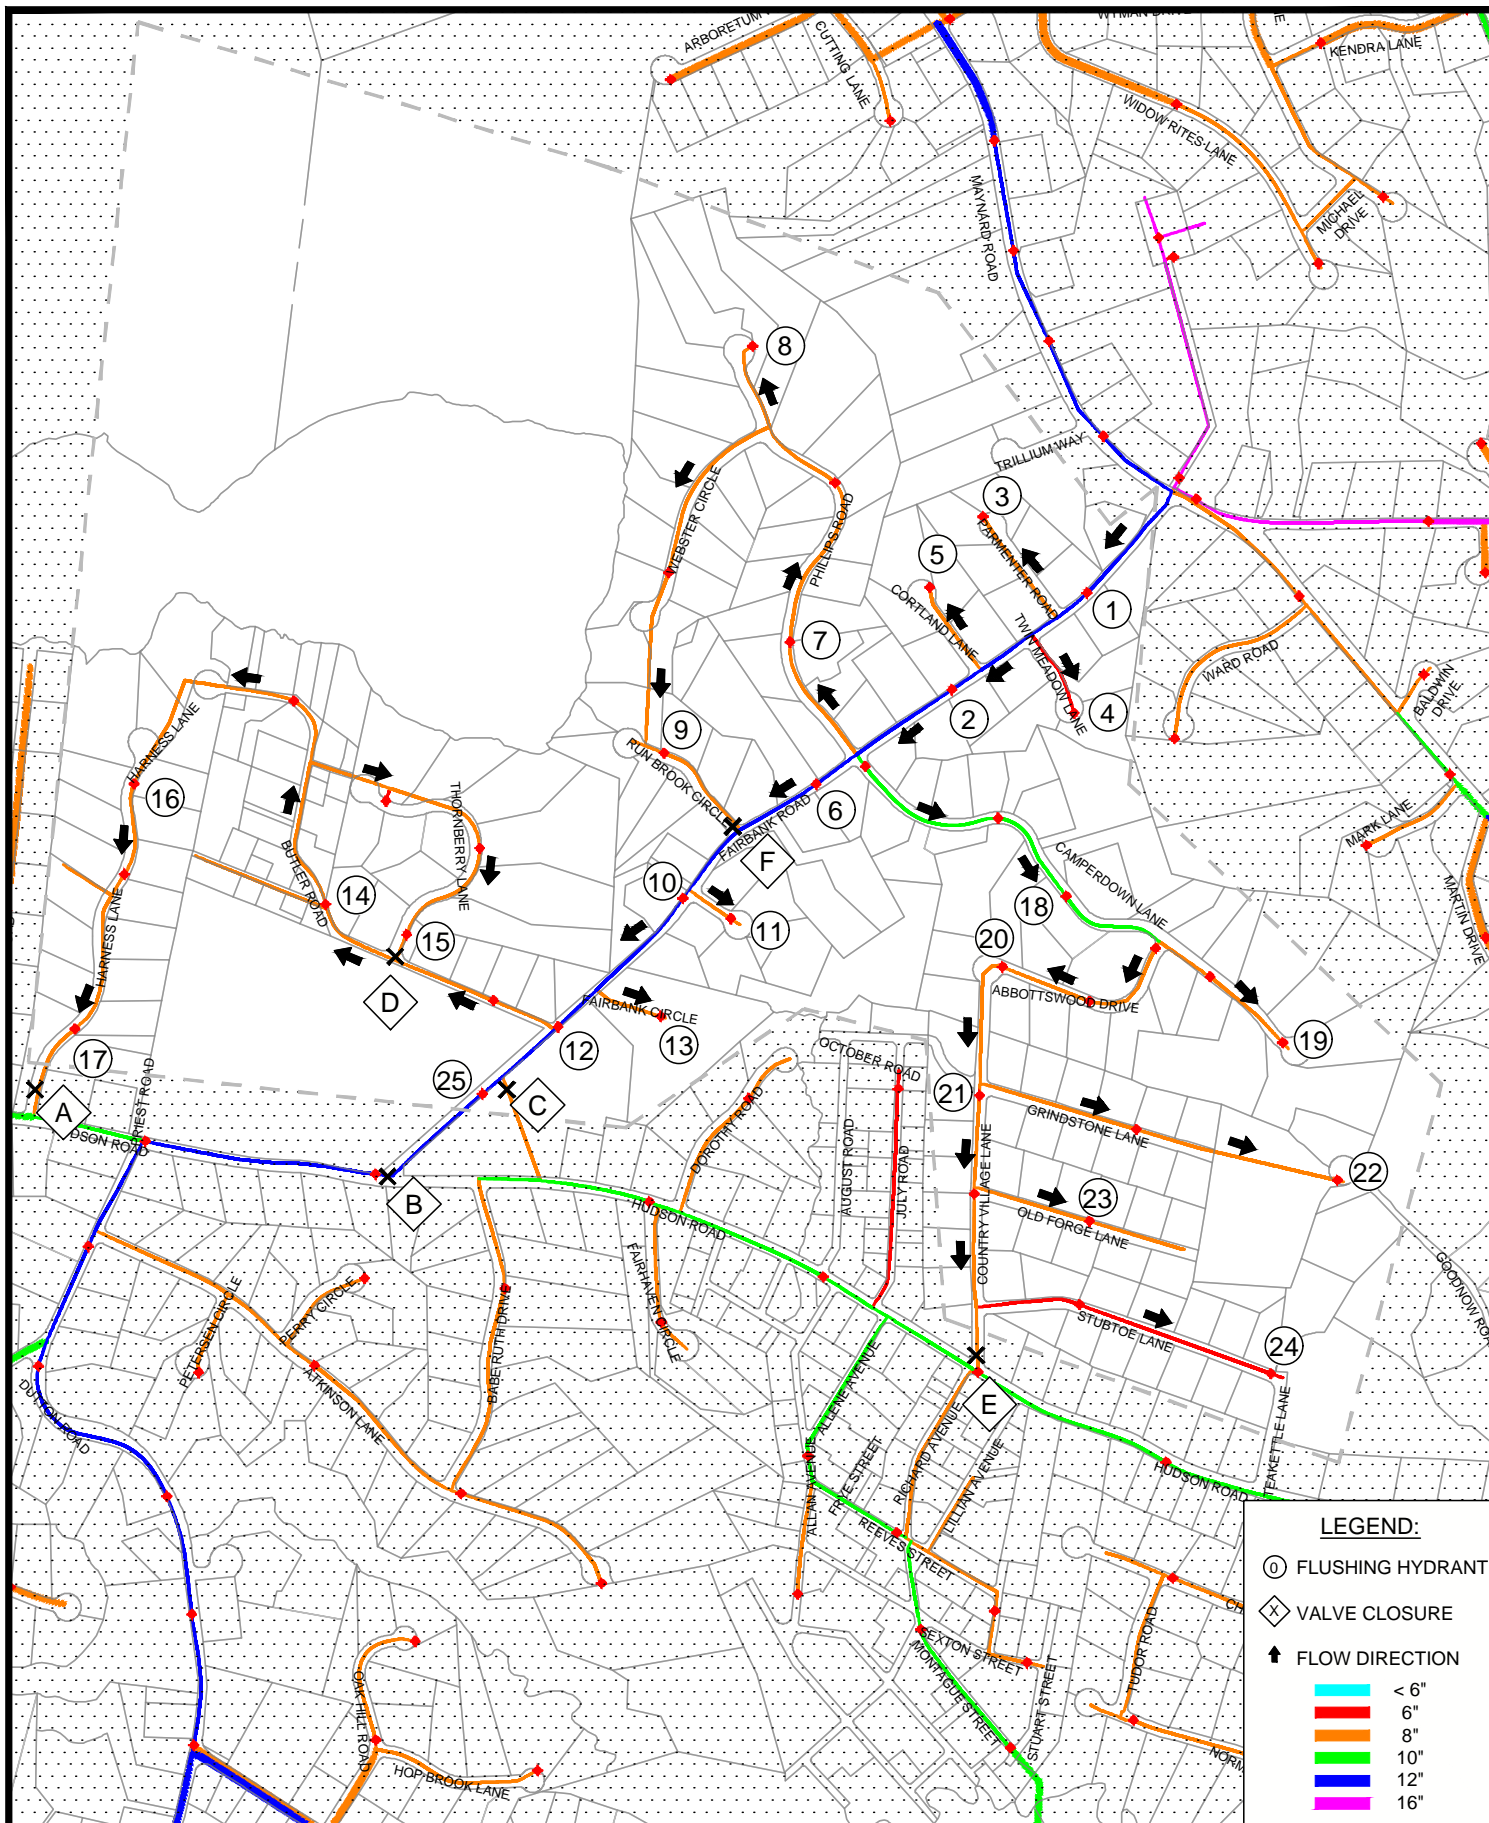

**LEGEND:**

- FLUSHING HYDRANT
- ✕ VALVE CLOSURE
- ↑ FLOW DIRECTION
- Color-coded pipe sizes:
  - < 6"
  - 6"
  - 8"
  - 10"
  - 12"
  - 16"

**ENVIRONMENTAL**  
 **PARTNERS**

APRIL 2021  
387-1901  
SCALE: 1" = 750'

SUDBURY WATER DISTRICT  
UNIDIRECTIONAL FLUSHING PROGRAM  
**ZONE: 12**  
Hydrants: 25  
Valves: 6

