


I:\SUDBURY WATER DISTRICT 387\387-1901 WATER SUPPLY MASTER PLAN\10 OPTIMIZATION OF DISTRIBUTION SYSTEM\FLUSHING PROGRAM\CAD\XREF\BASE MODEL.DWG



LEGEND:

- ① FLUSHING HYDRANT
- ◇ VALVE CLOSURE
- ↑ FLOW DIRECTION
- Color-coded lines for pipe sizes:
 - < 6"
 - 6"
 - 8"
 - 10"
 - 12"
 - 16"

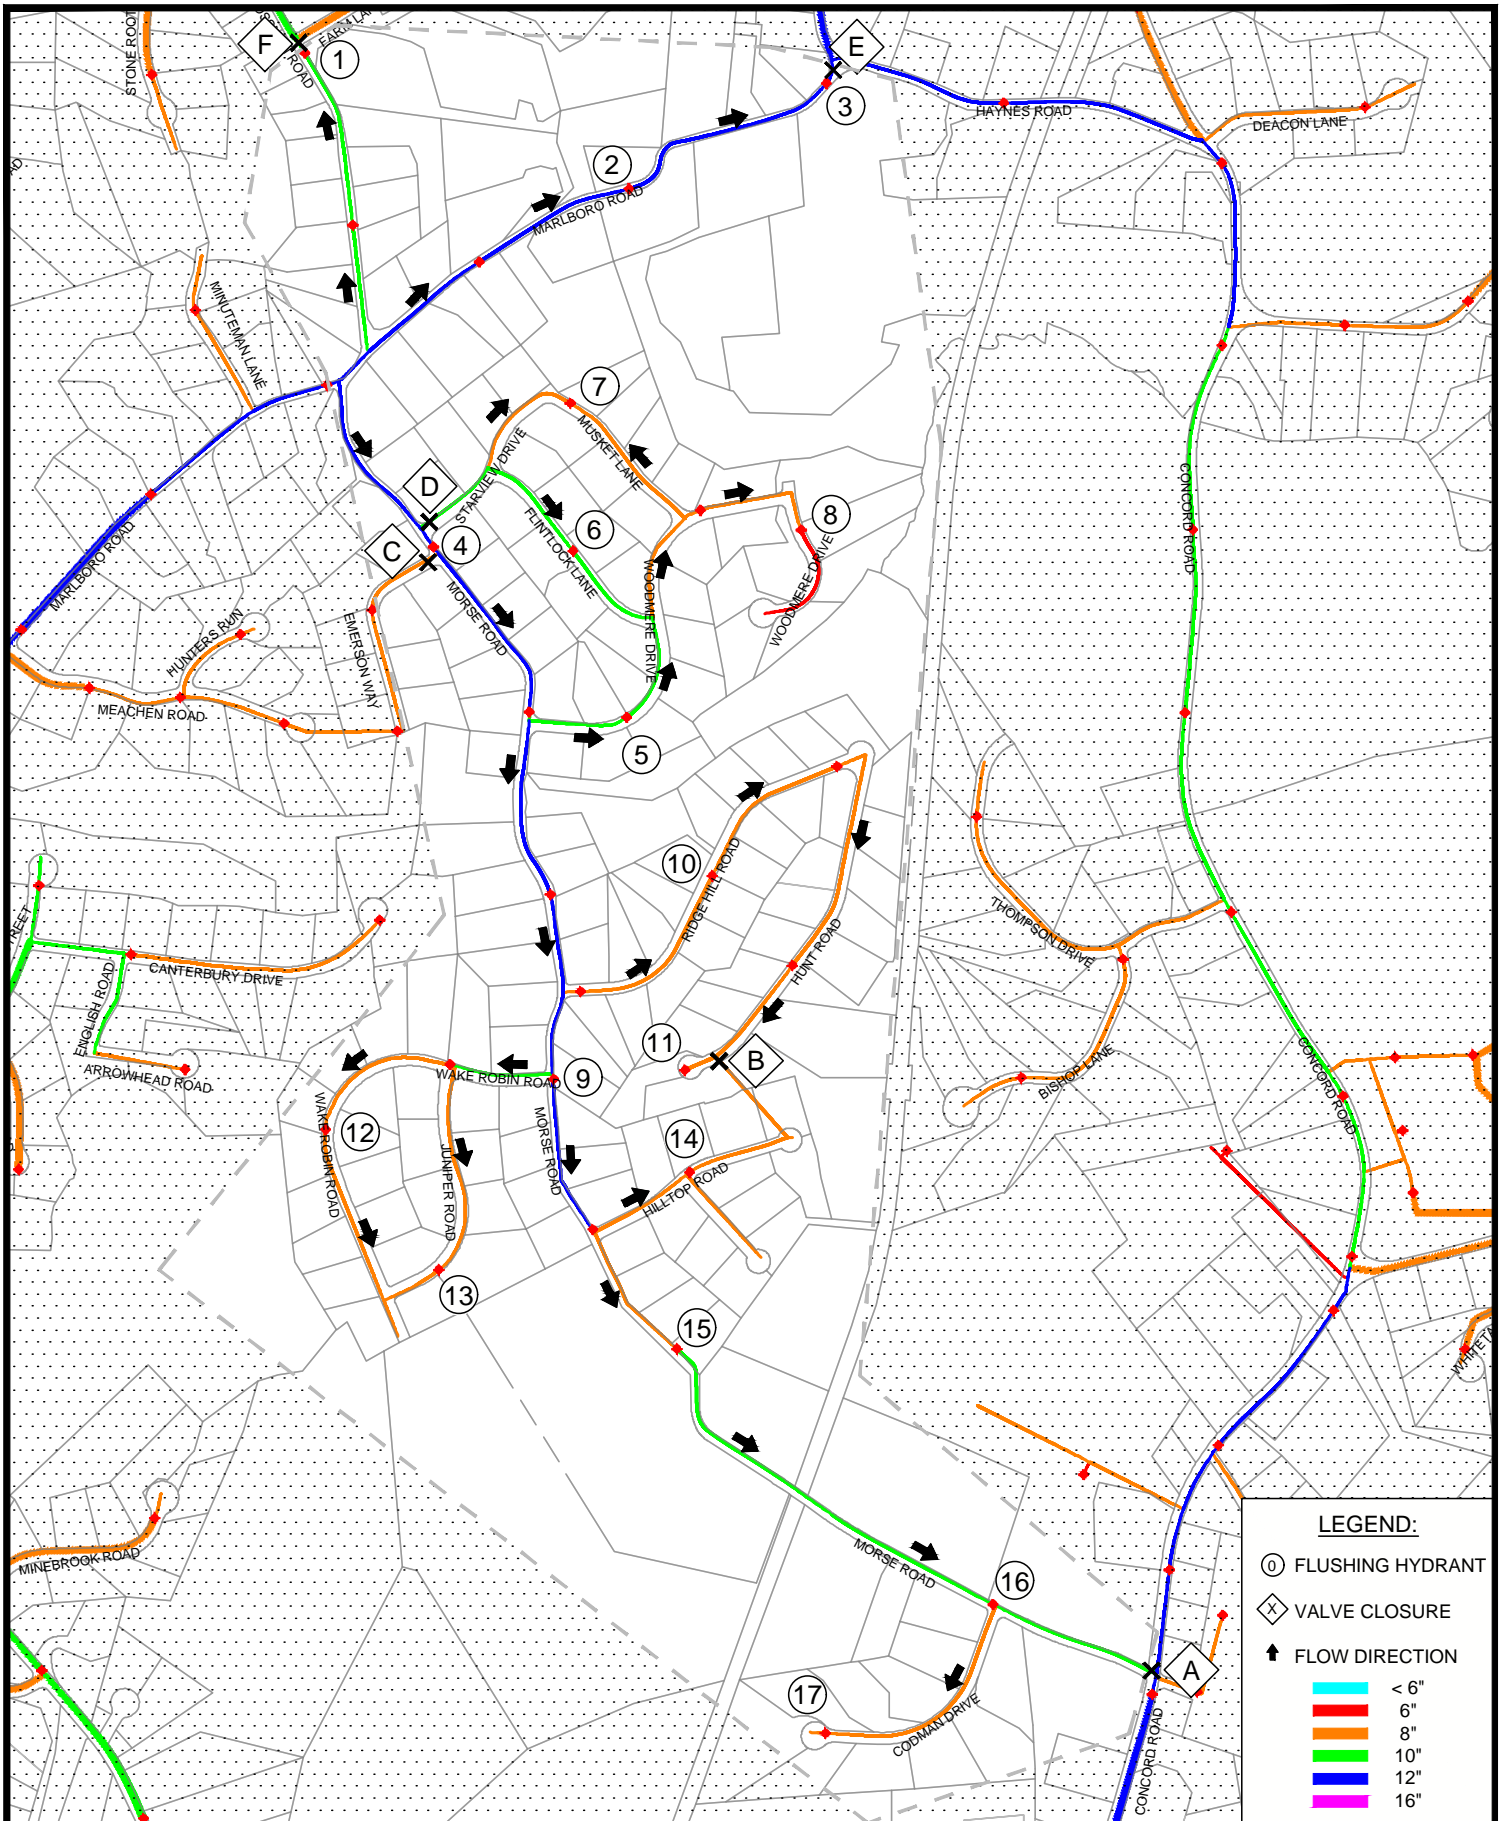

APRIL 2021
387-1901
SCALE: 1" = 750'

SUDBURY WATER DISTRICT
UNIDIRECTIONAL FLUSHING PROGRAM
ZONE: 4
Hydrants: 17
Valves: 6

