


I:\SUDBURY WATER DISTRICT 3871387-1901 WATER SUPPLY MASTER PLAN\10 OPTIMIZATION OF DISTRIBUTION SYSTEM FLUSHING PROGRAM\CAD\XREFS\BASE MODEL.DWG

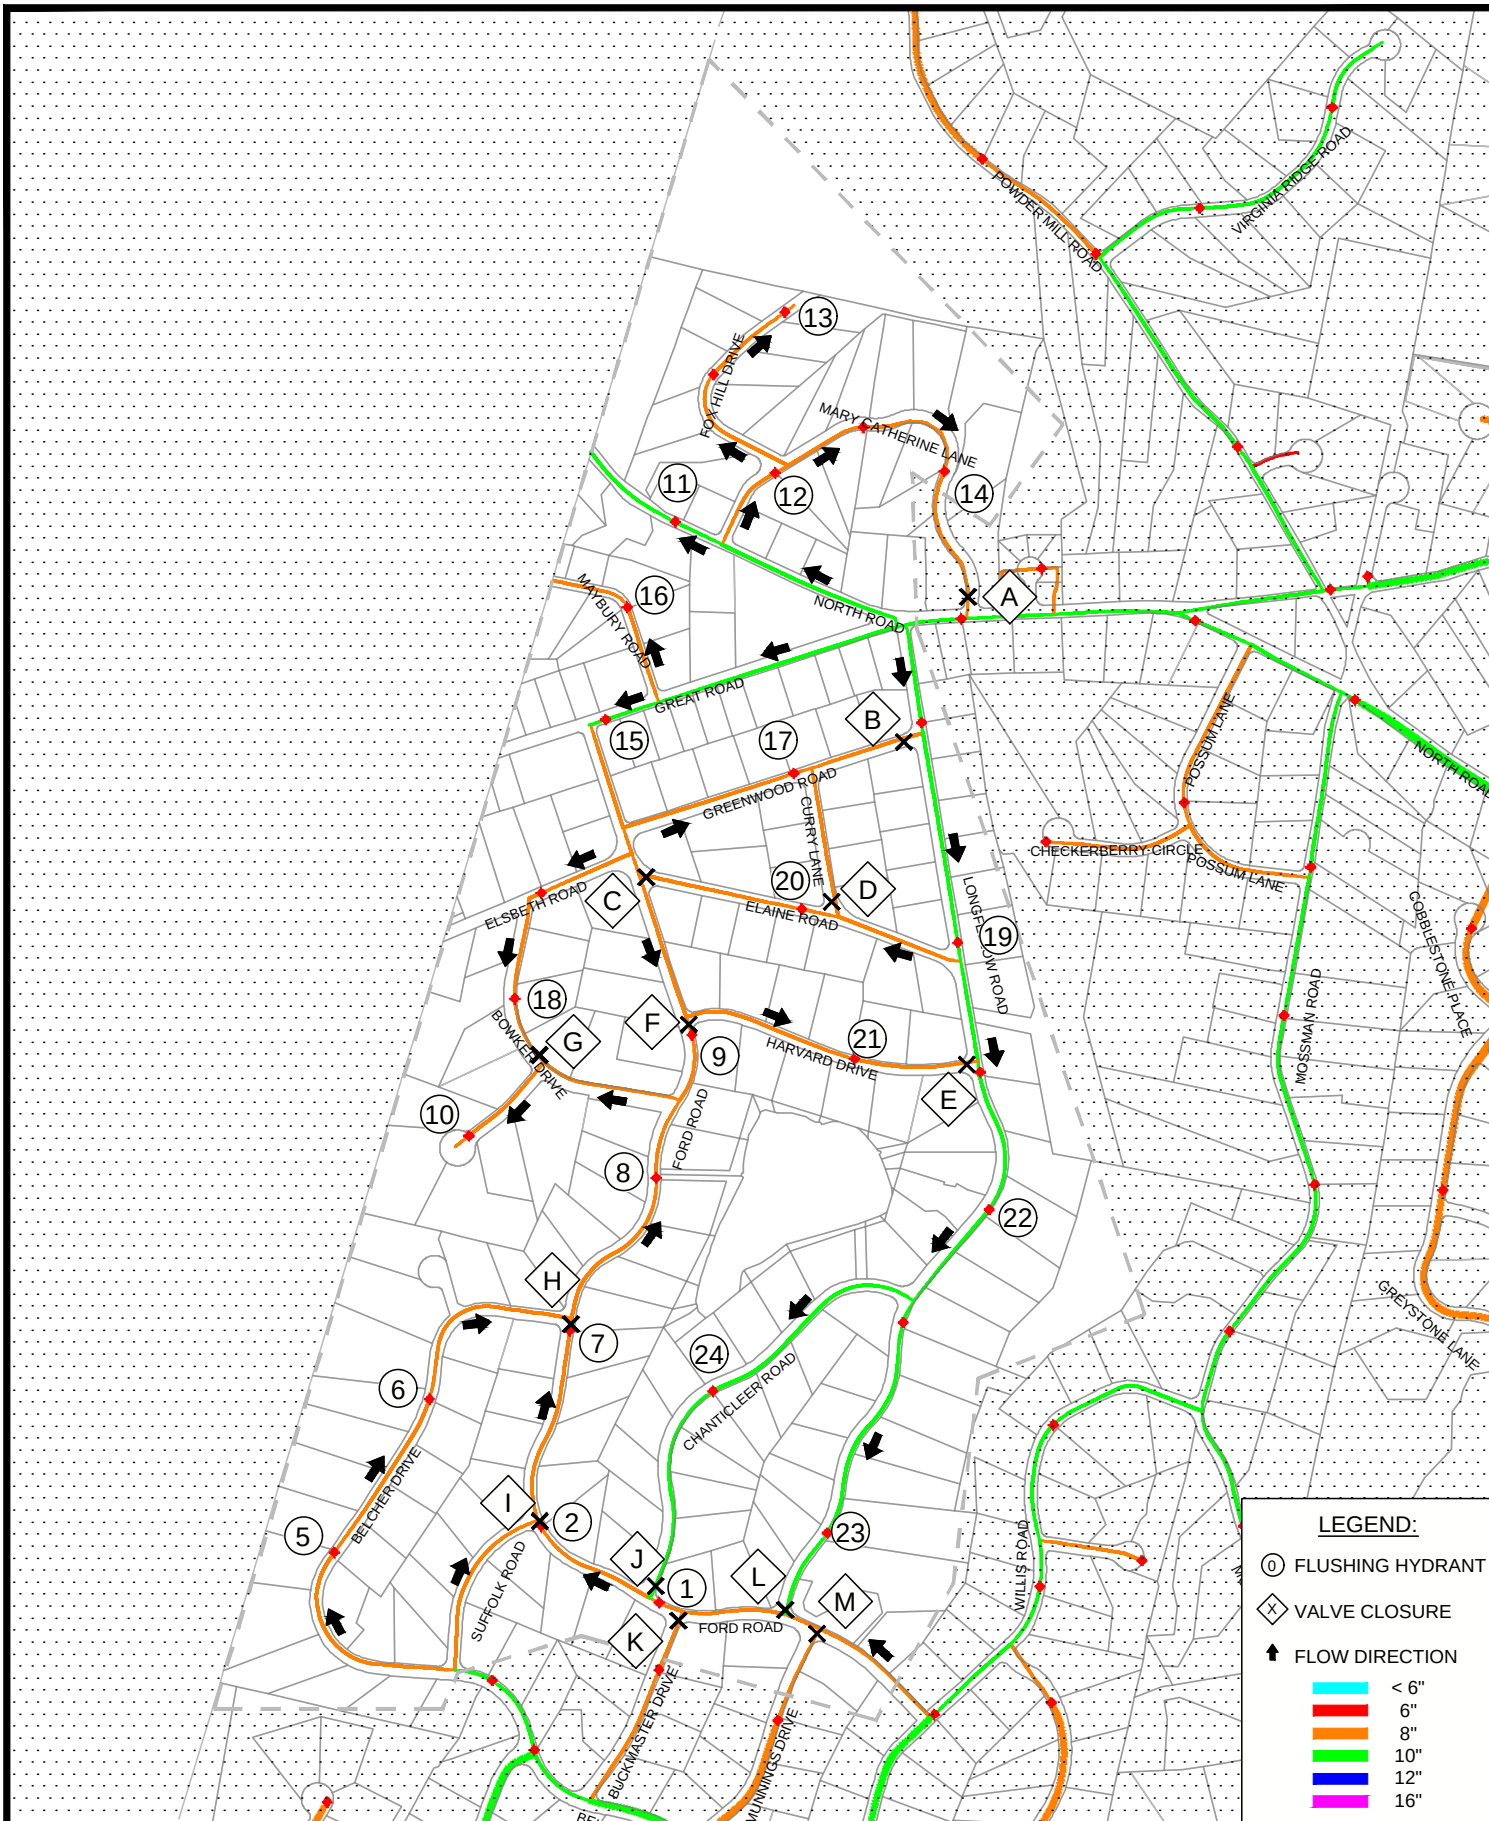

LEGEND:

- FLUSHING HYDRANT
- ⊠ VALVE CLOSURE
- ↑ FLOW DIRECTION
- < 6"
- 6"
- 8"
- 10"
- 12"
- 16"

ENVIRONMENTAL
 **PARTNERS**

APRIL 2021
387-1901
SCALE: 1" = 750'

SUDBURY WATER DISTRICT
UNIDIRECTIONAL FLUSHING PROGRAM

ZONE: 7

Hydrants: 24
Valves: 13

